
DO NOT SCALE FROM THIS DRAWING, WORK TO FIGURED DIMENSION ONLY.

## NOTES

- All DNA drawings are to be read in conjunction with the relevant DNA Specification and all relevant Architect's and Service Engineer's drawings and Specifications.
  For other notes refer to drawing 15.256-01

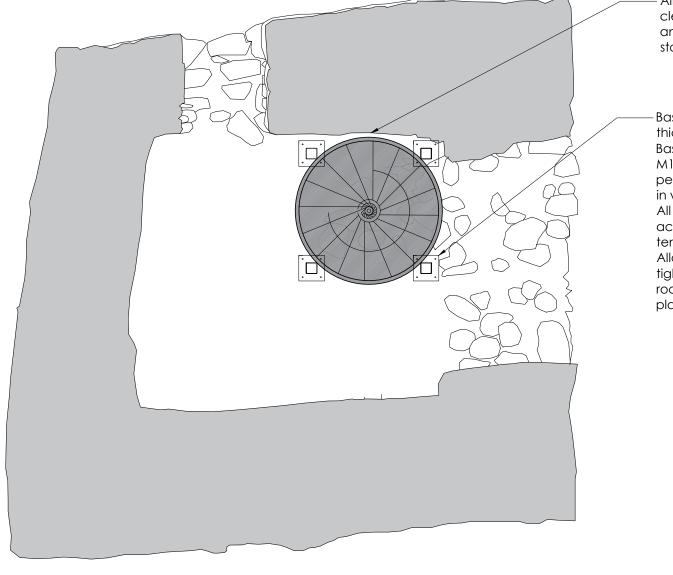

All loose stone and debris to be cleared away from base of stair and scrapped back to sound stone below base plates.

-Base plates to be 350x350x15mm

Base plate fixed to bedrock with M16 treaded rod with 300mm penetration into rock. Rods cast in with Rawl R-KF2 resin. All fixings to be site tested to achieve a minimum of 5KN tension.

Allow for 15mm grout to pack tight between baseplate and rock surface and ensure base plates are level

Indicative viewing platform fixing

